

THIRD CT "C" REQUIRED IF LINE TO NEUTRAL LOADS ARE PRESENT

Note: For parallel unit installation CT's must be installed on the load side of the DPM power connection point.

CUSTOMER INCOMING POWER

CUSTOMER LOAD

Danger!



Secondary leads of CT's(current sensors) must be properly terminated on P1 of the CT Interface Board (with a tightening torque of 4 in.lb) BEFORE the circuit being measured by the CT's is energized. Failure to do so may result in **LETHAL VOLTAGE** and severe damage to the CT's.

IMPORTANT!
INSTALL CURRENT SENSORS WITH THE ARROWS, AND THE A,B,(C) MARKINGS ON EACH SENSOR AS SHOWN ABOVE. INSTALLATION ON PROPER PHASE AND IN CORRECT DIRECTION IS CRITICAL. (FLEX-CORE) CT'S IS POSITIVE(+)

FACTORY INSTALLED JUMPERS ON P2 MUST REMAIN IN PLACE FOR SINGLE SYSTEM INSTALLATION

ATTENTION!
Always connect first 2 CT's to terminals A & B of P1. Terminal C is only used for a 3rd CT.

ENCLOSURE FRONT VIEW

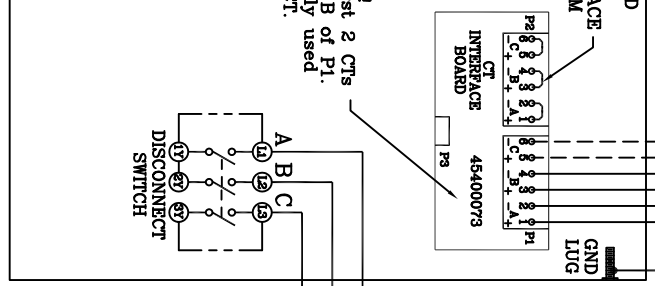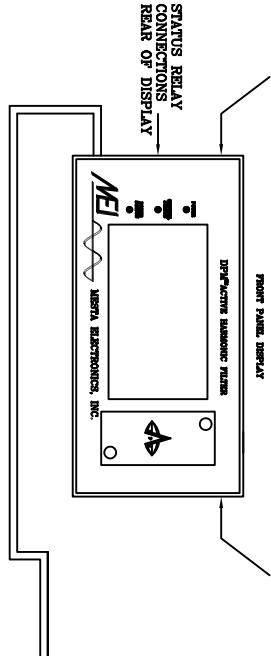

NEAREST BUILDING STRUCTURE STEEL TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES

BRANCH CIRCUIT PROTECTION DEVICE SUPPLIED BY CUSTOMER. SEE NOTES 1 & 2

INSTALLATION NOTES:

1. Carefully read the installation section of the owner's manual prior to installing this equipment
2. Mesta DPM is a parallel installed device. Input connections specified are the only power connections to be made.
3. Branch Circuit Protection Device Current Rating: 200 Amperes. (Supplied by Customer)
4. Input Wiring Current Rating: 200 Amperes. Input wiring size should be selected according to the current rating indicated above and in accordance with the applicable national and local electric codes.
5. 150 amp DPM Disconnect Switch: one conductor per pole

REVISIONS

REV	DATE	DESCRIPTION	BY	CHK
1	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME
2	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME
3	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME
4	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME
5	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME
6	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME
7	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME
8	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME
9	09/26/2018	REVISED TO COMPLY WITH LOCAL AND NATIONAL ELECTRICAL CODES	ME	ME

MESTA ELECTRONICS, INC.
150 AMP DPM
3RD GEN NI
CUSTOMER INSTALL.
45900024
1 OF 1